

Technical description

# Atlas & Calibra



Thermia AB is not liable or bound by warranty if these instructions are not adhered to during installation or service.

The English language is used for the original instructions.  
Other languages are a translation of the original instructions.  
(Directive 2006/42/EC)


© Copyright Thermia AB

## Table of Contents


<b>1</b>	<b>Transportation, space requirement and Recommended location</b> .....	<b>4</b>
1.1	Transportation .....	4
1.2	Space requirement and recommended location .....	5
<b>2</b>	<b>Heat pump data, dimensions and connections</b> .....	<b>7</b>
2.1	Atlas and Calibra .....	7
2.2	Atlas Duo and Calibra Duo .....	8
2.3	Envelope for Atlas and Calibra .....	9
<b>3</b>	<b>Atlas 12 400V &amp; 230V</b> .....	<b>11</b>
3.1	Technical data, Atlas 12 .....	11
3.2	Estimated flow and pressure for brine for Atlas 12 .....	12
3.3	Estimated flow and pressure for heating circuit, Atlas 12 .....	13
3.4	Supply line temp 35° and 55°C for Atlas 12 and Atlas Duo 12 .....	15
<b>4</b>	<b>Atlas 18 400V</b> .....	<b>17</b>
4.1	Technical data, Atlas 18 .....	17
4.2	Estimated flow and pressure for brine for Atlas 18 .....	18
4.3	Estimated flow and pressure for heating circuit, Atlas 18 .....	19
4.4	Supply line temp 35° and 55°C for Atlas 18 and Atlas Duo 18 .....	20
<b>5</b>	<b>Calibra 7 400V &amp; 230V</b> .....	<b>22</b>
5.1	Technical data, Calibra 7 .....	22
5.2	Estimated flow and pressure for brine, Calibra 7 and Calibra Duo 7 .....	24
5.3	Estimated flow and pressure for heating circuit, Calibra 7 and Calibra Duo 7 .....	25
5.4	Supply line temp 35°C and 55°C for Calibra 7, Calibra Duo 7 .....	26
<b>6</b>	<b>Calibra 12 400V &amp; 230V</b> .....	<b>28</b>
6.1	Technical data, Calibra 12 .....	28
6.2	Estimated flow and pressure for brine, Calibra 12 and Calibra Duo 12 .....	29
6.3	Estimated flow and pressure for heating circuit, Calibra 12 and Calibra Duo 12 .....	30
6.4	Supply line temp 35° and 55°C for Calibra12 and Calibra Duo 12 .....	32

## 1 Transportation, space requirement and Recommended location

### 1.1 Transportation

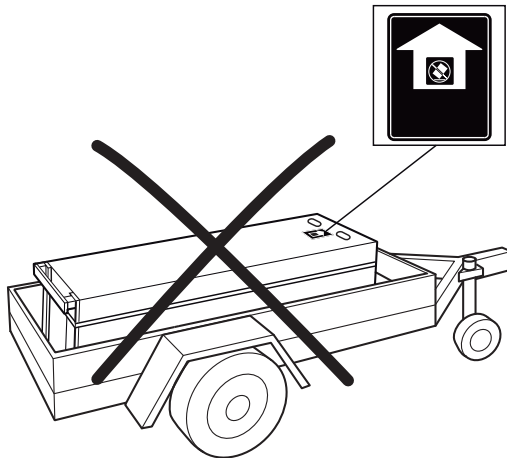


The heat pump must not be transported lying down!

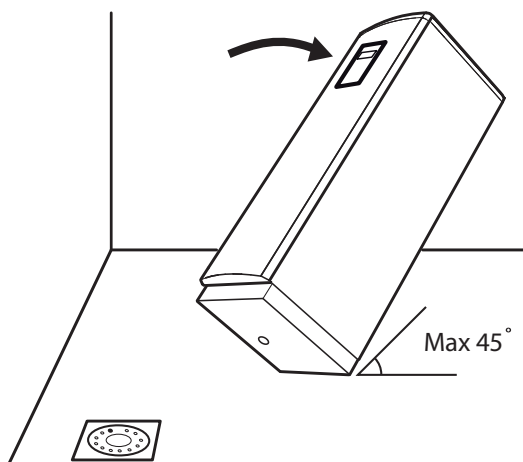


Maximum tilt 45 °

Atlas & Calibra




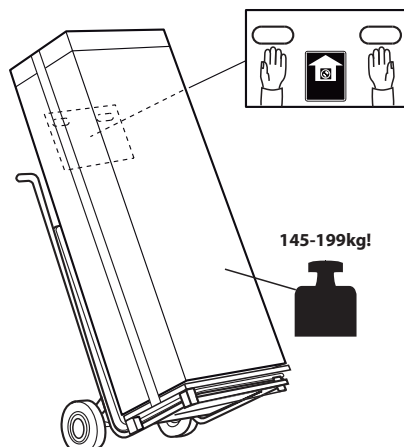


Atlas Duo & Calibra Duo

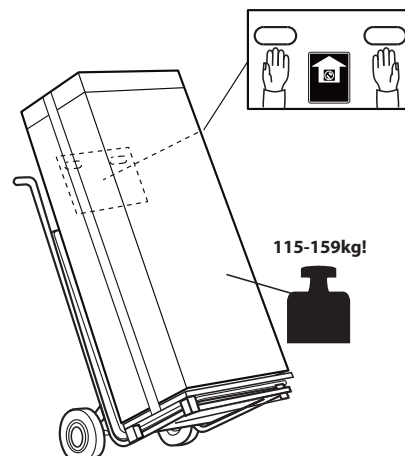



## 1.2 Space requirement and recommended location

Avoid placing the heat pump in a corner or near a bedroom. The surrounding walls can amplify the sound from the heat pump.

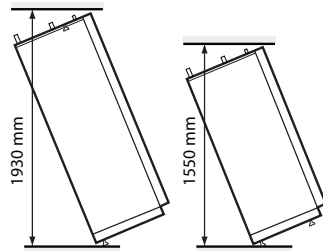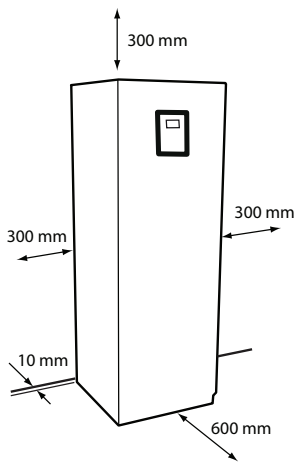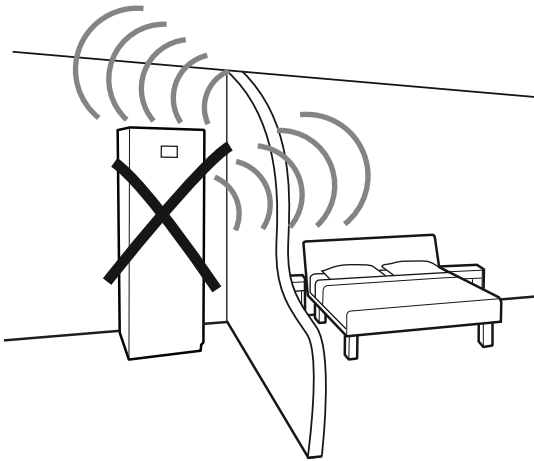

Adjust the heat pump using the adjustable feet so that it is horizontal on the ground.

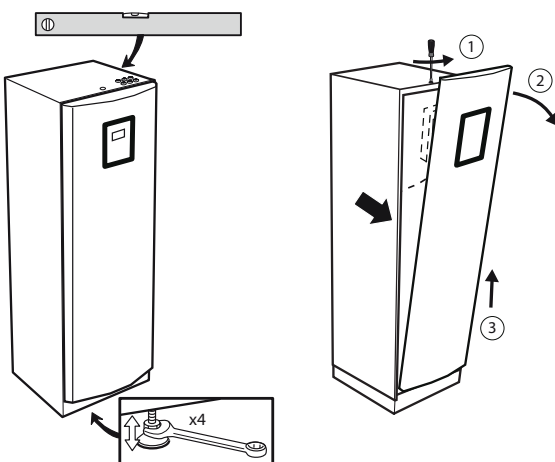

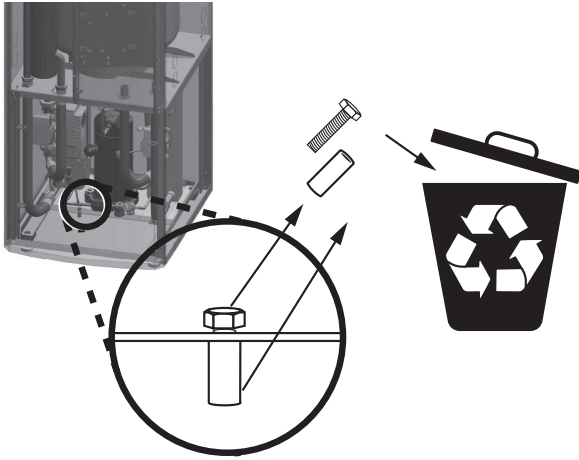


When the heat pump is in position, remove the transport safety. (If the heat pump should be moved further, put back the transport safety screw.) Make sure all parts of the transport safety is removed!

The heat pump should be placed on a stable floor with a floor well (so any condensation may drain from the condensation hole in the bottom of the heat pump), preferably a concrete floor. When placed on a wooden floor, the floor should be reinforced to hold the weight of the heat pump, including a filled water heater. Consider that condensation water may drip from the drain hole, so take the necessary steps to protect the floor.

# Technical description Atlas & Calibra


## 2 Heat pump data, dimensions and connections

### 2.1 Atlas and Calibra

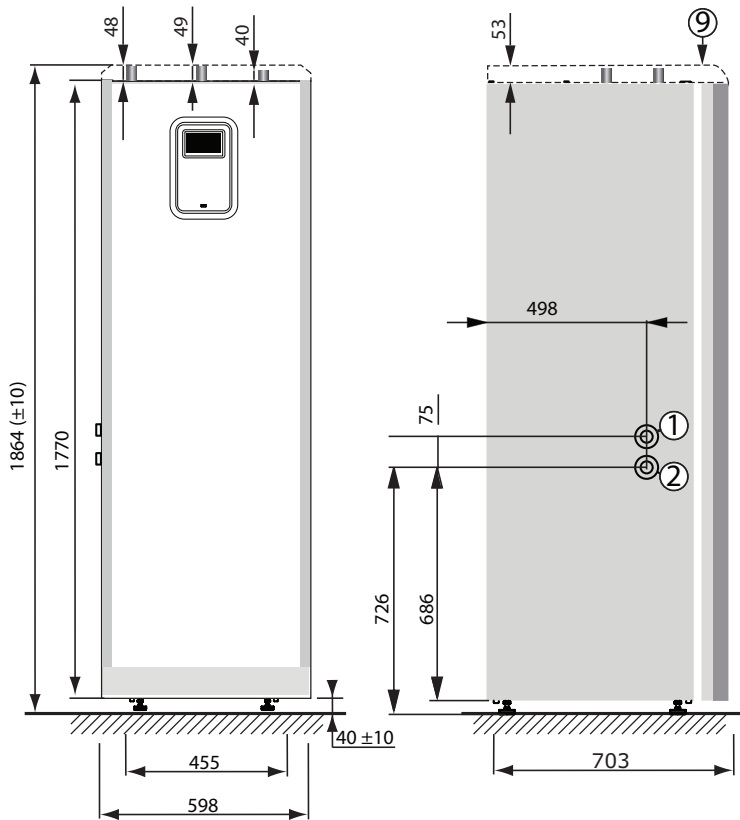


- 1 Brine in, 28 mm (left or right)
- 2 Brine out, 28 mm (left or right)
- 3 Heating system supply pipe, 28 mm
- 4 Heating system return pipe, 28 mm
- 5 Connection for bleed valve, 28 mm
- 6 Hot water line, 22 mm
- 7 Cold water line, 22 mm
- 8 Lead-in for supply, sensor and communication cables
- 9 Top hood, Atlas (accessory for Calibra)

The brine lines (1) and (2) can be connected on either the left or right-hand sides or to the two knock out holes on the top.

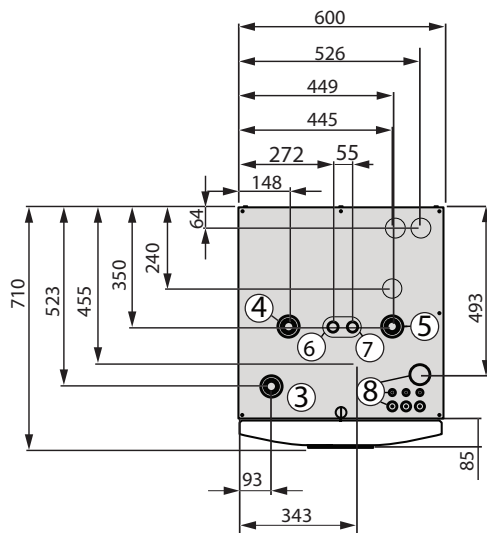


## 2.2 Atlas Duo and Calibra Duo

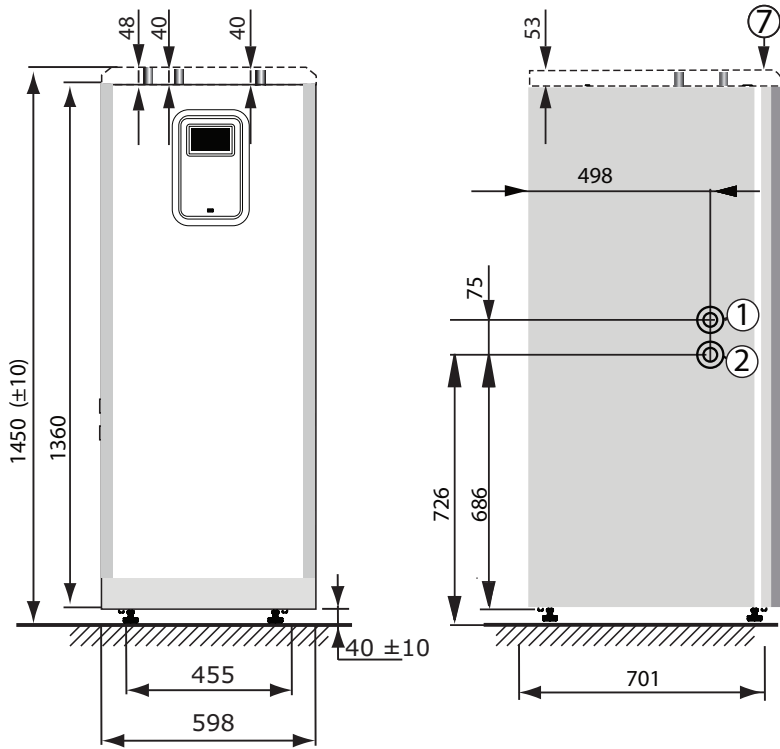

- 1 Brine in, 28 mm (left or right)
- 2 Brine out, 28 mm (left or right)
- 3 Heating system supply pipe, 28 mm
- 4 Heating system return pipe, 28 mm
- 5 Connection for bleed valve, 28 mm
- 6 Lead-in for supply, sensor and communication cables
- 7 Top hood, Atlas (accessory for Calibra)

The brine lines (1) and (2) can be connected on either the left or right-hand side or to the two knock out holes on the top.

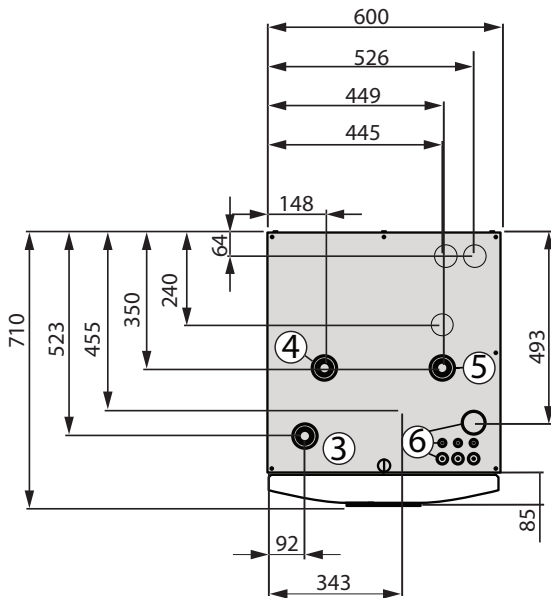


# Technical description Atlas & Calibra

## 2.3 Envelope for Atlas and Calibra


Calibra 7  
Calibra12  
Atlas 12

R410A	
T brine °C	T water °C
20	63
10	65
5	65
0	65
-5	65
-10	60
-10	20
5	20
20	30
20	63

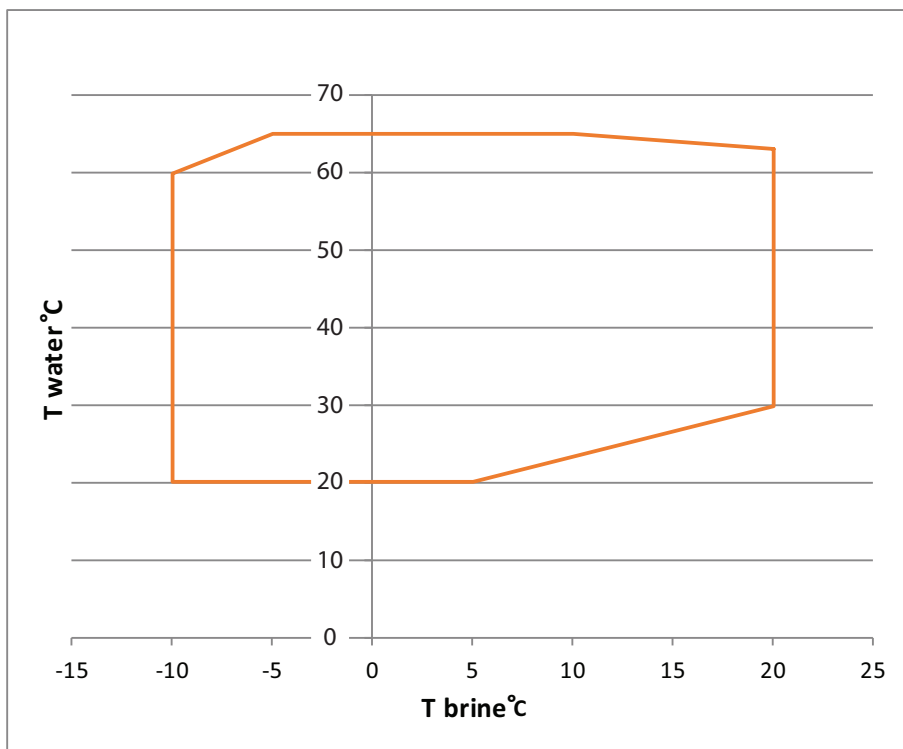

### Atlas 18

R410A	
T brine °C	T water °C
20	63
15	65
5	65
0	65
-5	65
-10	63
-10	20
5	20
20	30
20	63

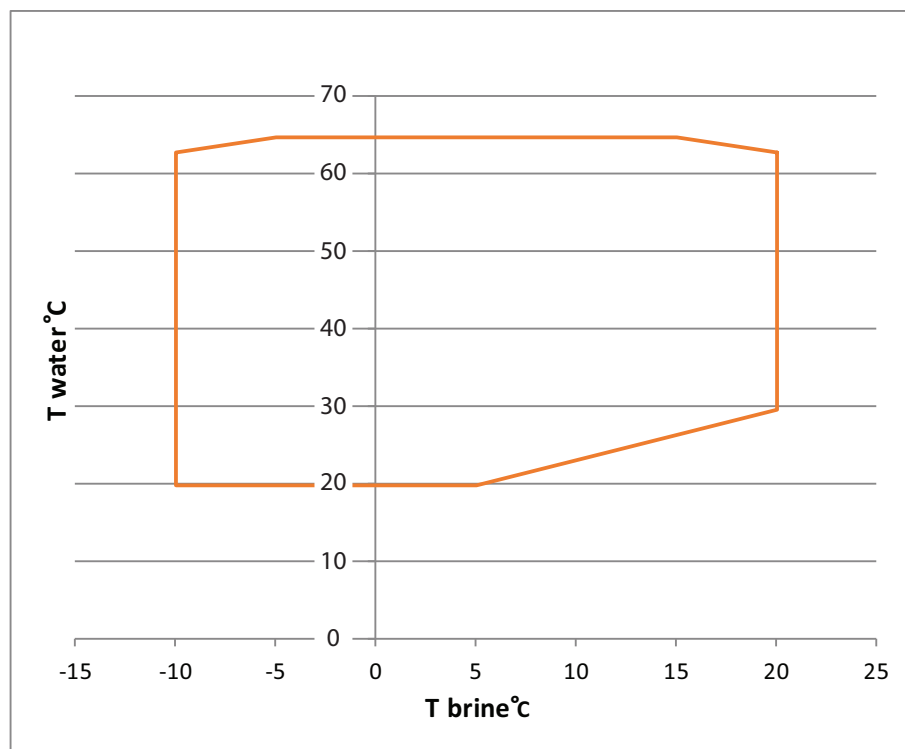

## Technical description Atlas & Calibra

### 3 Atlas 12 400V & 230V

#### 3.1 Technical data, Atlas 12

Atlas 12 400V and 230V		Unit	3-12 kW
Refrigerant	Type		R410A
	Amount <sup>1</sup>	kg	1,40
	GWP		2088
	CO <sup>2</sup> equivalent	tons	2923
	Design pressure	Bar (g)	45
Compressor	Type		Scroll
	Oil		POE
Electrical data, 400V, 3-N	Mains power supply	Volt	400~3N
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	0/3/6/9
	Fuses, combined <sup>2</sup>	A	(10)/16/20/25
Electrical data, 230V, 3-P	Mains power supply	Volt	230~3
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	0/3/5/8
	Fuses, combined <sup>2</sup>	A	(25)/32/32/40
	Fuse separate supply (compressor only)	A	25
	Fuse separate supply, Immersion heater only	A	16/25/40
Electrical data, 230V, 1-N	Mains power supply	Volt	230~1N
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	0/3/5/8
	Fuses, combined <sup>2</sup>	A	(25)/40/50/63
	Fuse separate supply (compressor only)	A	25
	Fuse separate supply, Immersion heater only	A	16/25/40
Performance	SCOP, floor heating (35°C) <sup>3</sup>		5,86
	SCOP, radiator heating (55°C) <sup>3</sup>		4,39
	COP <sup>4</sup>		4,75
Energy class-system <sup>5</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
Energy class-product <sup>6</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
	Hot water (Economy) <sup>7</sup>		A+
	Hot water (Normal/Comfort) <sup>8</sup>		A
Min/Max temperature	Brine	°C	20/-10
	Heating	°C	65/20
Anti freeze type <sup>9</sup>	Ethanol + water solution -17°C ± 2		
Pressure limits refrigerant circuit	Low pressure	bar(g)	2,3
	Operating pressure	bar(g)	41,5
	High pressure	bar(g)	45,0

Sound power level	Atlas	dB(A)	30-43 <sup>10</sup> (33) <sup>11</sup>
	Atlas Duo	dB(A)	31-45 <sup>10</sup> (34) <sup>11</sup>
Hot water performance	Volume 40°C hot water <sup>12</sup>	l	307
	COP, hot water <sup>7</sup>		3,07
	Hot water including HGW <sup>13</sup>	l	488
Hot water tank, size	Atlas	l	184
	Atlas Duo	l	Optional
Water mains		bar(g)	9
Weight	Atlas, empty	kg	177
	Atlas, filled	kg	367
	Atlas Duo	kg	127
Dimensions (WxDxH)	Atlas	mm	598x703x1863 +/-10
	Atlas Duo	mm	598x703x1450 +/-10

1) The refrigerant circuit is hermetically sealed and contains refrigerants covered by the F-gas regulation. GWP for R410A according to EC 517/2014 is 2088, which gives a CO2 equivalent corresponding to Atlas 12: 2.923 tons, Atlas 18: 4.072 tons.

2) The minimum recommended fuse size depends on the limitation of the electrical immersion heater in combination with the compressor. The maximum permissible power for immersion heater can also be set differently with and without compressor for further adjustment at low fuses. 400V versions: The power supply and the frequency converter for the compressor are powered by L1, L2 and L3. Control and circulation pumps are operated with L1. Meets IEC61000-3-12 at Ssc connection point <1.3 MVA for Atlas 12 and for Atlas 18 <2.1 MVA without action 230V versions: The feeding for auxiliary heater and compressor can be physically separated.

3) SCOP according to EN14825, cold climate (Helsinki), P-design Atlas 12: 10.5 kW (B0W55), 11.5 kW (B0W35). P-design Atlas 18: 15.7 kW (B0W55), 15.1 kW (B0W35).

4) At B0 / W35, according to EN14511

5) When the heat pump is installed in a heating system that is controlled via the heat pump's control computer. According to EU regulation 811/2013.

6) When the heat pump is not connected to a heating system, and the function of the built-in control computer is not taken into account. According to EU regulation 811/2013.

7) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Economy mode and built-in hot water tank.

8) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Normal / Comfort mode and built-in processor.

9) Local regulations and regulations must always be checked before antifreeze agents are used.

10) Sound power level measured according to EN12102 and EN 3741 (min / max B0W35).



11) Sound power level according to energy labeling, measured according to EN12102 and EN3741 (B0W55).

12) Hot water performance according to EN16147, V40 according to XL cycle with the control computer set for comfort mode and built-in hot water tank.

13) Maximum available amount of hot water when the boiler has been able to fully charge using HGW operation and subsequent V40 discharge in accordance with EN16147



## 3.2 Estimated flow and pressure for brine for Atlas 12

### Flow brine and external available pressure B0W35 ( Δt 3 )

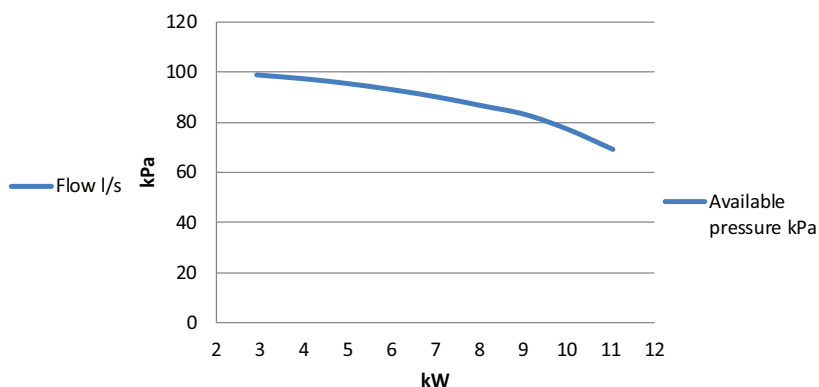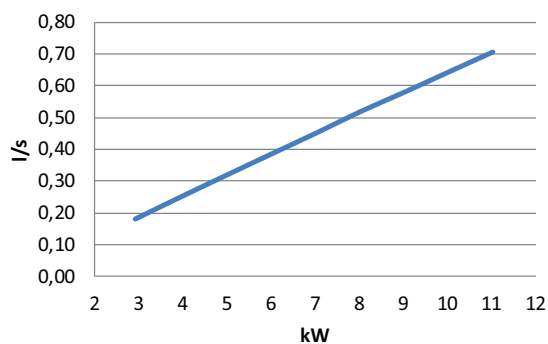



# Technical description Atlas & Calibra

## Flow brine and external available pressure B0W55 ( $\Delta t$ 3 )

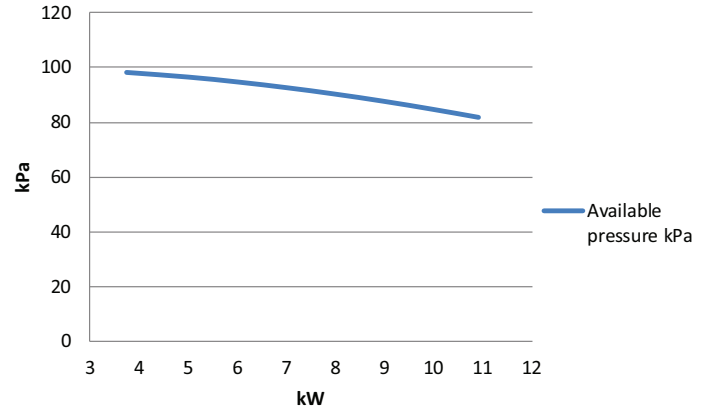
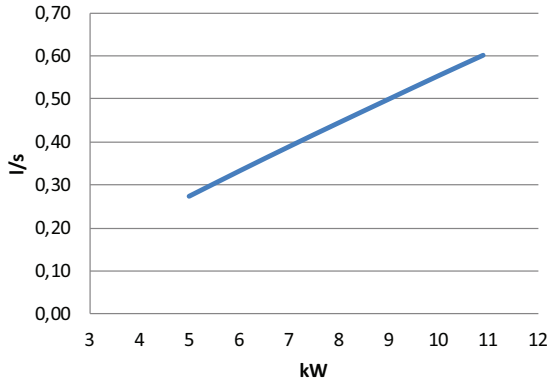


### 3.3 Estimated flow and pressure for heating circuit, Atlas 12

## Flow heating circuit and external available pressure B0W35 ( $\Delta t$ 5 )

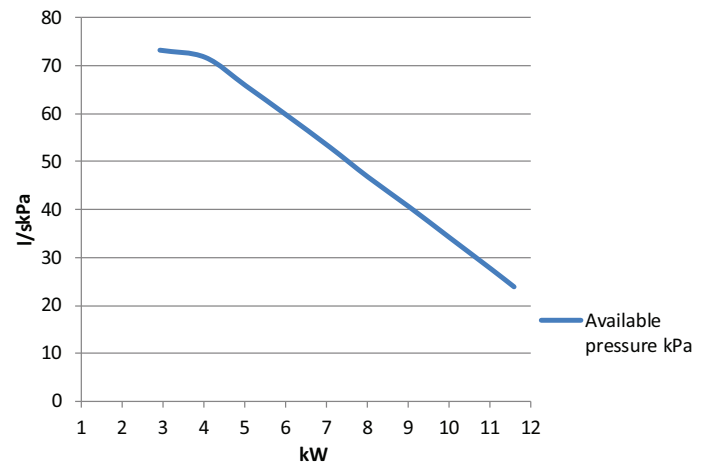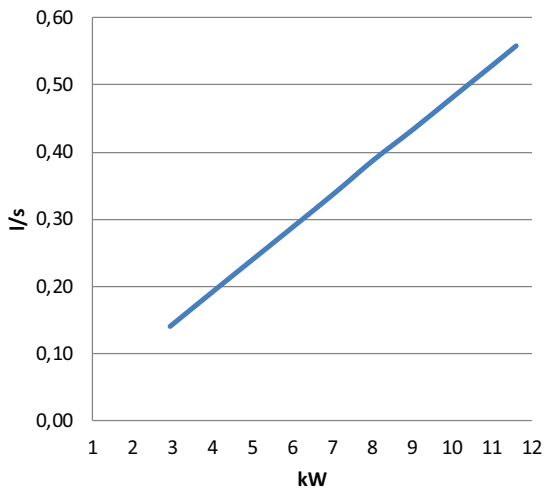


## Flow heating circuit and external available pressure B0W55 ( $\Delta t$ 8 )

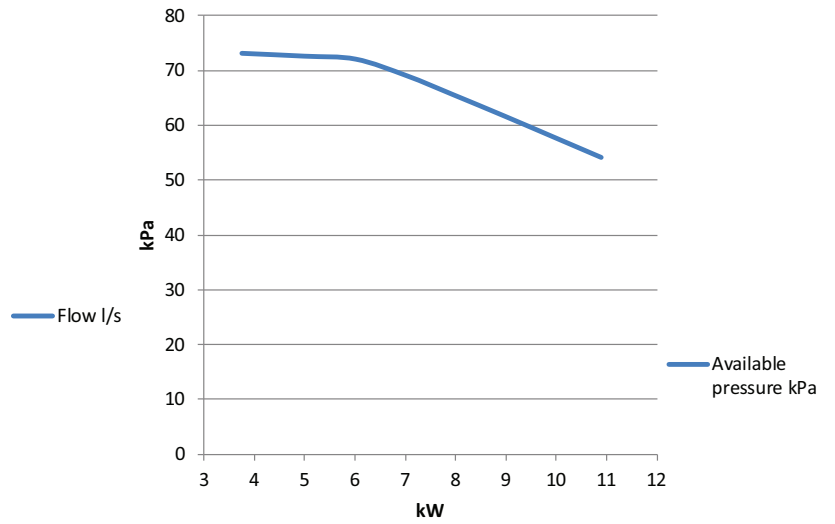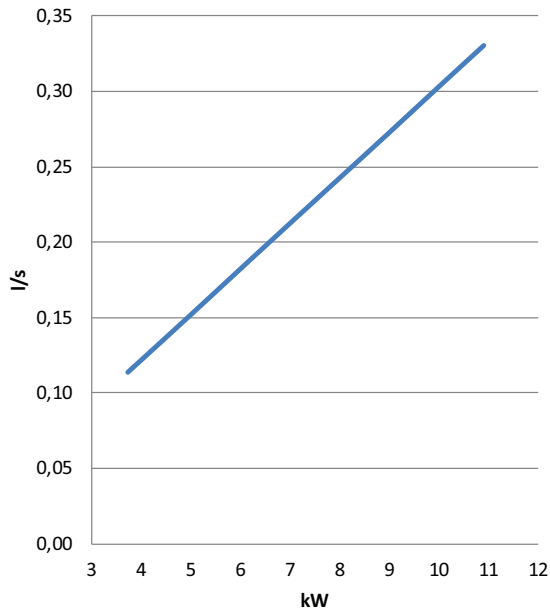

## Technical description Atlas & Calibra


### 3.4 Supply line temp 35° and 55°C for Atlas 12 and Atlas Duo 12

Heating capacity with a desired supply line temperature at 35°C at different compressor speed and brine temperature. At higher brine temperatures max compressor speed may be automatically reduced to below 5300 max RPM

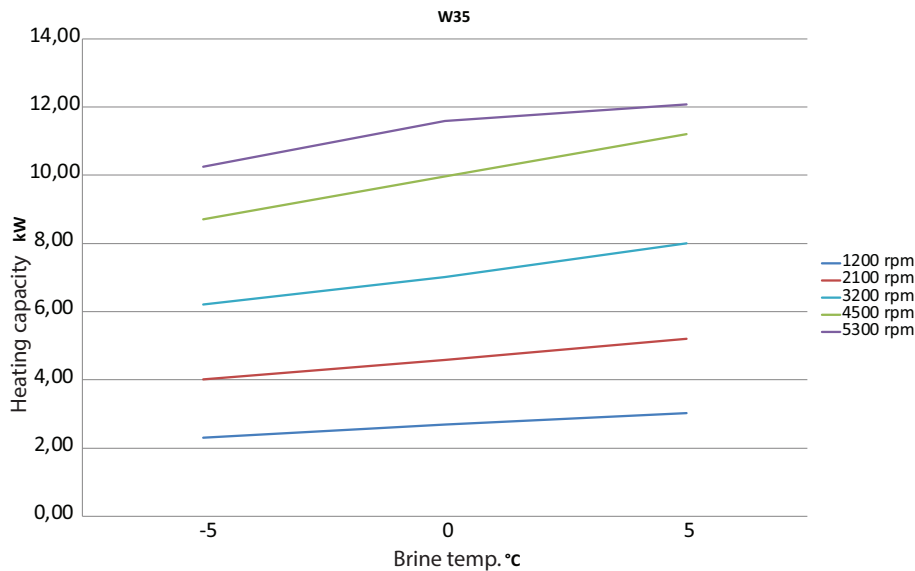

RPM	Brine temp.	-5	0	+5
1200	Heating capacity (kW)	2,3	2,7	3,0
	Input power (kW)	0,7	0,7	0,7
	COP	3,5	4,1	4,6
2100	Heating capacity (kW)	4,0	4,6	5,2
	Input power (kW)	1,0	1,0	1,0
	COP	4,0	4,6	5,3
3200	Heating capacity (kW)	6,2	7,0	8,0
	Input power (kW)	1,5	1,5	1,5
	COP	4,1	4,7	5,3
4500	Heating capacity (kW)	8,7	10,0	11,2
	Input power (kW)	2,2	2,2	2,2
	COP	4,0	4,6	5,2
5300	Heating capacity (kW)	10,2	11,6	12,1
	Input power (kW)	2,6	2,7	2,7
	COP	3,9	4,4	4,6

Heating capacity with a desired supply line temperature at 55°C at different compressor speed and brine temperature. At higher brine temperatures max compressor speed may be automatically reduced to below 5300 max RPM

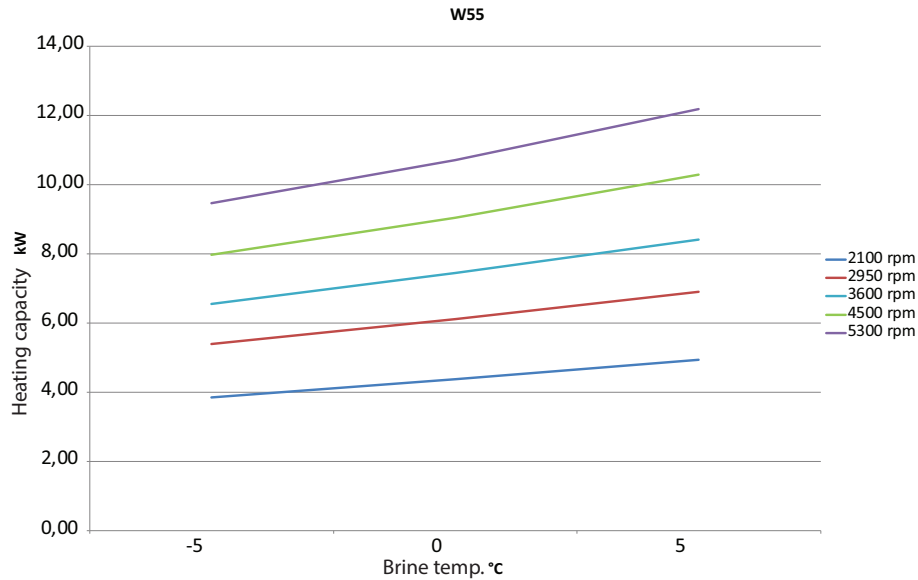

RPM	Brine temp.	-5	0	+5
2100	Heating capacity (kW)	3,9	4,4	4,9
	Input power (kW)	1,5	1,5	1,5
	COP	2,6	2,9	3,2
2950	Heating capacity (kW)	5,4	6,1	6,9
	Input power (kW)	2,0	2,0	2,1
	COP	2,7	3,0	3,4
3600	Heating capacity (kW)	6,6	7,5	8,4
	Input power (kW)	2,4	2,4	2,5
	COP	2,8	3,1	3,4
4500	Heating capacity (kW)	8,0	9,1	10,3
	Input power (kW)	3,0	3,1	3,1
	COP	2,7	3,0	3,3
5300	Heating capacity (kW)	9,5	10,7	12,2
	Input power (kW)	3,7	3,7	3,8
	COP	2,6	2,9	3,2

## Technical description Atlas & Calibra

### 4 Atlas 18 400V


#### 4.1 Technical data, Atlas 18

Atlas 18 400V and 230V		Unit	4-18 kW
Refrigerant	Type		R410A
	Amount <sup>1</sup>	kg	1,95
	CO <sup>2</sup> equivalent	tons	4,072
	Design pressure	Bar (g)	45
Compressor	Type		Scroll
	Oil		POE
Electrical data, 400V, 3-N	Mains power supply	Volt	400~3N
	Max working power, compressor	kW	6,7
	Rated power, circulation pumps	kW	0,3
	Immersion heater, 3 steps	kW	(0)/3/6/9
	Fuses, combined <sup>2</sup>	A	(13)/20/25/32
Performance	SCOP, floor heating (35°C) <sup>3</sup>		6,15
	SCOP, radiator heating (55°C) <sup>3</sup>		4,55
	COP <sup>4</sup>		4,98
Energy class-system <sup>5</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
Energy class-product <sup>6</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
	Hot water (Economy) <sup>7</sup>		A+
	Hot water (Normal/Comfort) <sup>8</sup>		A
Min/Max temperature	Brine	°C	20/-10
	Heating	°C	65/20
Anti freeze type <sup>9</sup>	Ethanol + water solution -17°C ± 2		
Pressure limits refrigerant circuit	Low pressure	bar(g)	2,3
	Operating pressure	bar(g)	41,5
	High pressure	bar(g)	45,0
Sound power level	Atlas	dB(A)	32-45 <sup>10</sup> (36) <sup>11</sup>
	Atlas Duo	dB(A)	33-46 <sup>10</sup> (37) <sup>11</sup>
Hot water performance	Volume 40°C hot water <sup>12</sup>	l	344
	COP, hot water <sup>7</sup>		3,05
	Hot water including HGW <sup>13</sup>	l	545
Hot water tank, size	Atlas	l	184
	Atlas Duo	l	Optional
Water mains		bar(g)	9
Weight	Atlas, empty	kg	187
	Atlas, filled	kg	377
	Atlas Duo	kg	147
Dimensions (WxDxH)	Atlas	mm	598x703x1863 +/-10
	Atlas Duo	mm	598x703x1450 +/-10


- 1) The refrigerant circuit is hermetically sealed and contains refrigerants covered by the F-gas regulation. GWP for R410A according to EC 517/2014 is 2088, which gives a CO2 equivalent corresponding to Atlas 12: 2.923 tons, Atlas 18: 4.072 tons.
- 2) The minimum recommended fuse size depends on the limitation of the electrical immersion heater in combination with the compressor. The maximum permissible power for immersion heater can also be set differently with and without compressor for further adjustment at low fuses. 400V versions: The power supply and the frequency converter for the compressor are powered by L1, L2 and L3. Control and circulation pumps are operated with L1. Meets IEC61000-3-12 at Ssc connection point <1.3 MVA for Atlas 12 and for Atlas 18 <2.1 MVA without action 230V versions: The feeding for auxiliary heater and compressor can be physically separated.
- 3) SCOP according to EN14825, cold climate (Helsinki), P-design Atlas 12: 10.5 kW (B0W55), 11.5 kW (B0W35). P-design Atlas 18: 15.7 kW (B0W55), 15.1 kW (B0W35).
- 4) At B0 / W35, according to EN14511
- 5) When the heat pump is installed in a heating system that is controlled via the heat pump's control computer. According to EU regulation 811/2013.
- 6) When the heat pump is not connected to a heating system, and the function of the built-in control computer is not taken into account. According to EU regulation 811/2013.
- 7) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Economy mode and built-in hot water tank.
- 8) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Normal / Comfort mode and built-in processor.
- 9) Local regulations and regulations must always be checked before antifreeze agents are used.
- 10) Sound power level measured according to EN12102 and EN 3741 (min / max B0W35).
- 11) Sound power level according to energy labeling, measured according to EN12102 and EN3741 (B0W55).
- 12) Hot water performance according to EN16147, V40 according to XL cycle with the control computer set for comfort mode and built-in hot water tank.
- 13) Maximum available amount of hot water when the boiler has been able to fully charge using HGW operation and subsequent V40 discharge in accordance with EN16147

## 4.2 Estimated flow and pressure for brine for Atlas 18

### Flow brine and external available pressure B0W35 ( Δt 3 )

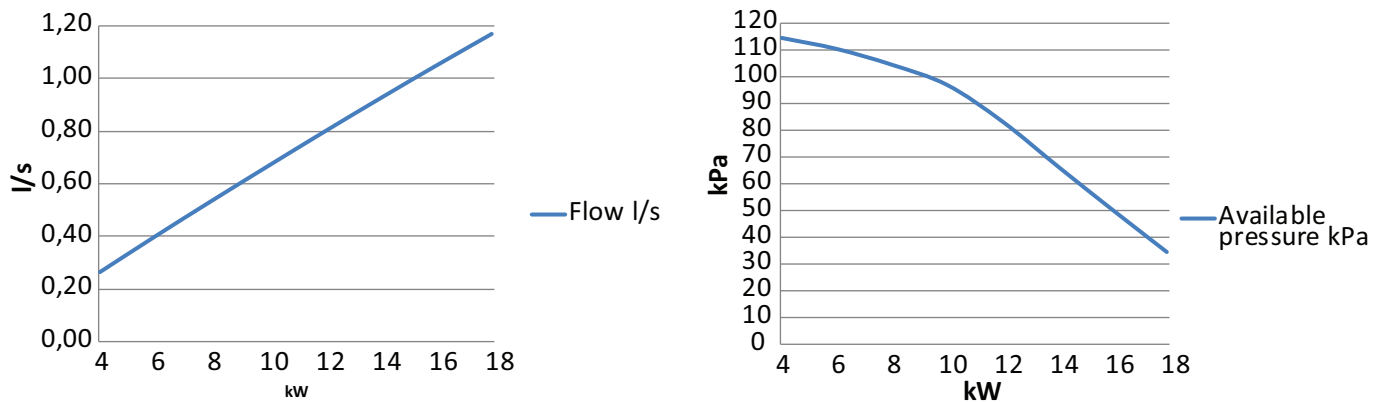



### Flow brine and external available pressure B0W55 ( Δt 3 )

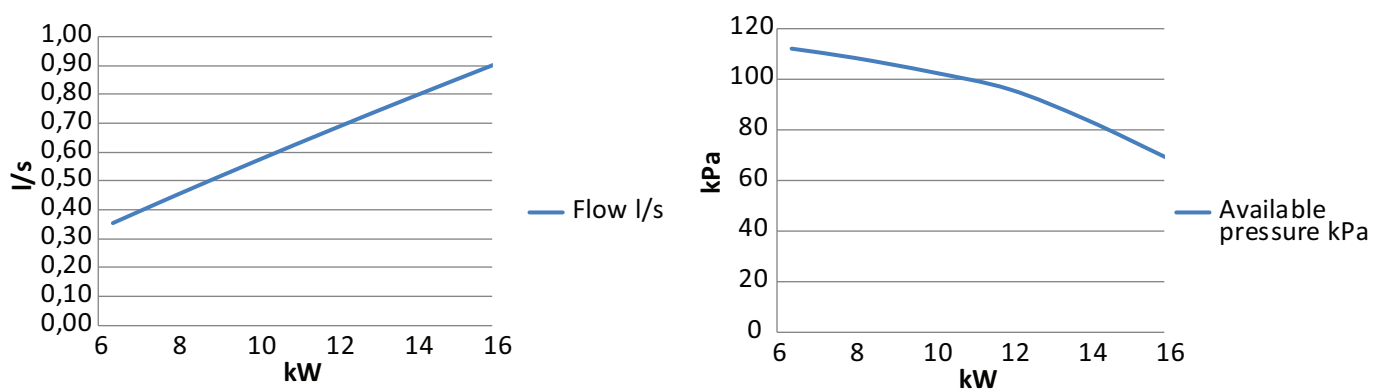



# Technical description Atlas & Calibra

## 4.3 Estimated flow and pressure for heating circuit, Atlas 18

### Flow heating circuit and external available pressure B0W35 ( $\Delta t$ 5 )

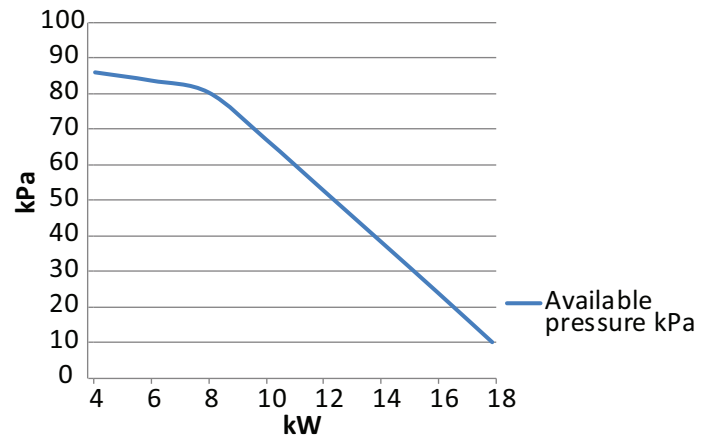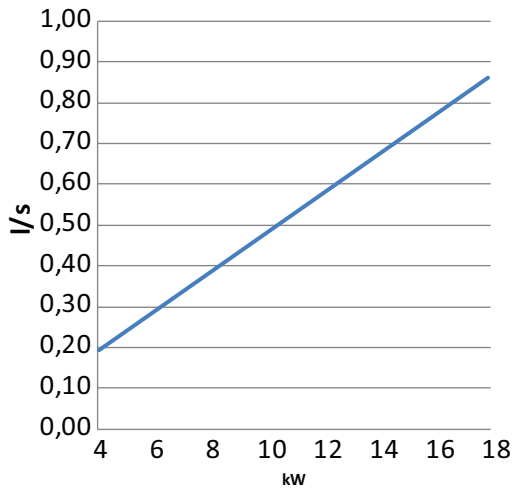


### Flow heating circuit and external available pressure B0W55 ( $\Delta t$ 8 )

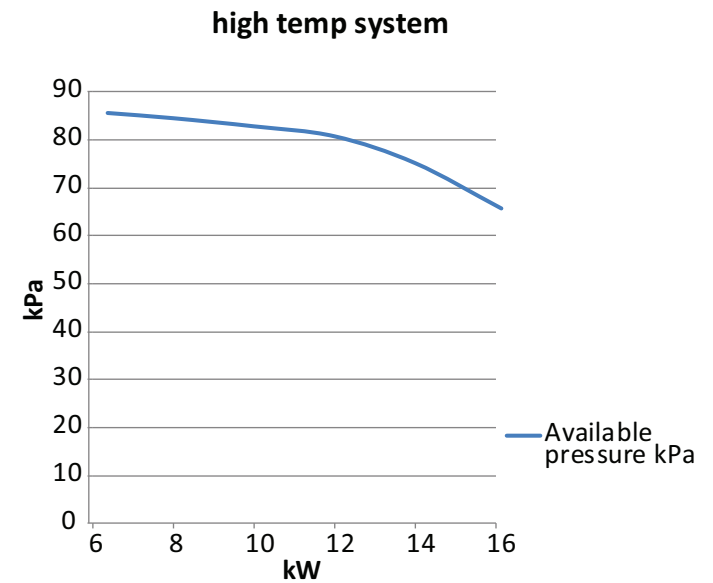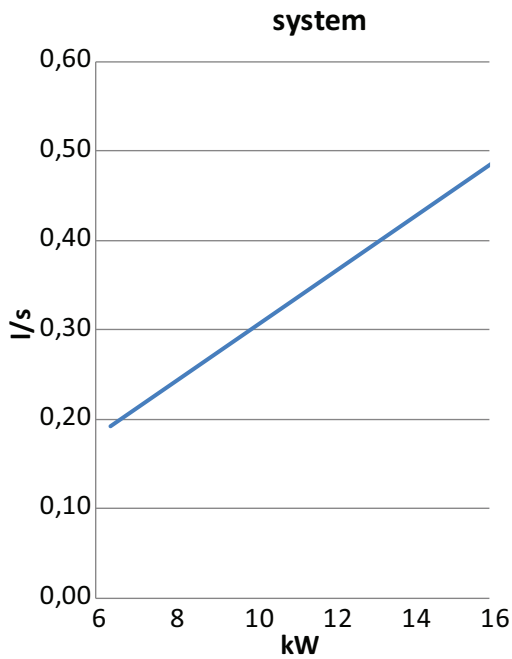

## 4.4 Supply line temp 35° and 55°C for Atlas 18 and Atlas Duo 18


Heating capacity with a desired supply line temperature at 55° at different compressor speed and brine temperatures.

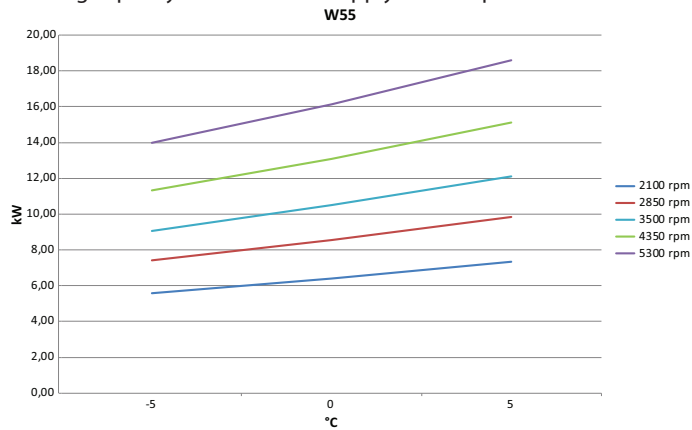

RPM	Brine temp.	-5	0	+5
2110	Heating capacity (kW)	5,6	6,4	7,3
	Input power (kW)	2,2	2,2	2,2
	COP	2,6	2,9	3,3
2850	Heating capacity (kW)	7,4	8,6	9,8
	Input power (kW)	2,8	2,8	2,9
	COP	2,7	3,0	3,4
3500	Heating capacity (kW)	9,1	10,5	12,1
	Input power (kW)	3,3	3,4	3,5
	COP	2,7	3,1	3,4
4350	Heating capacity (kW)	11,3	13,1	15,1
	Input power (kW)	4,2	4,3	4,5
	COP	2,7	3,0	3,4
5300	Heating capacity (kW)	14,0	16,1	18,6
	Input power (kW)	5,2	5,4	5,6
	COP	2,7	3,0	3,3

# Technical description Atlas & Calibra

Heating capacity with a desired supply line temperature at 35° at different compressor speed and brine temperatures.

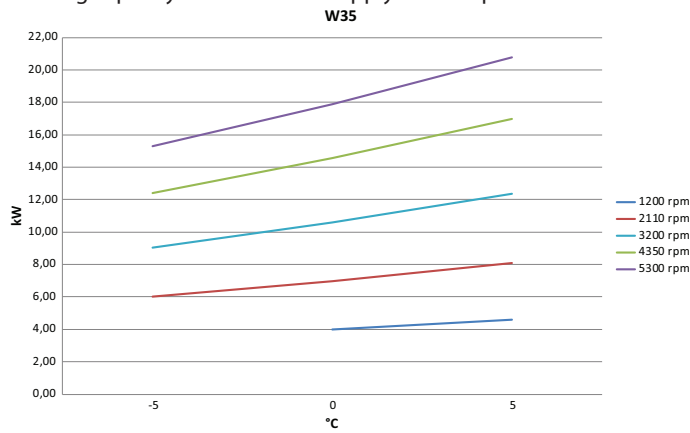

RPM	Brine temp.	-5	0	+5
1200	Heating capacity (kW)	*	4,0	4,6
	Input power (kW)	*	0,9	0,9
	COP	*	4,4	5,2
2110	Heating capacity (kW)	6,0	7,0	8,1
	Input power (kW)	1,4	1,4	1,4
	COP	4,3	5,0	5,9
3200	Heating capacity (kW)	9,0	10,6	12,3
	Input power (kW)	2,1	2,1	2,2
	COP	4,3	5,0	5,7
4350	Heating capacity (kW)	12,4	14,6	17,0
	Input power (kW)	3,0	3,1	3,2
	COP	4,2	4,8	5,3
5300	Heating capacity (kW)	15,3	17,9	20,8
	Input power (kW)	3,8	4,0	4,3
	COP	4,0	4,5	4,9

\* Outside envelope

## 5 Calibra 7 400V & 230V

### 5.1 Technical data, Calibra 7

Calibra 7 400V and 230V		Unit	1,5-7 kW
Refrigerant	Type		R410A
	Amount <sup>1</sup>	kg	0,95
	CO <sup>2</sup> equivalent	tons	198,3
	Design pressure	Bar (g)	45
Compressor	Type		Scroll
	Oil		POE
Electrical data, 400V, 3-N	Mains power supply	Volt	400~3N
	Max working power, compressor	kW	2,63
	Rated power, circulation pumps	kW	0,12
	Immersion heater, 3 steps	kW	2/4/6
	Fuses, combined <sup>2</sup>	A	(13)/13/13/16
Electrical data, 230V, 3-P	Mains power supply	Volt	230~3
	Max working power, compressor	kW	2,63
	Rated power, circulation pumps	kW	0,12
	Immersion heater, 3 steps	kW	2/4/6
	Fuses, combined <sup>2</sup>	A	20/25/32
	Fuse separate supply (compressor only)	A	13
	Fuse separate supply, Immersion heater only	A	10/16/25
Electrical data, 230V, 1-N	Mains power supply	Volt	230~1N
	Max working power, compressor	kW	2,63
	Rated power, circulation pumps	kW	0,12
	Immersion heater, 3 steps	kW	2/4/6
	Fuses, combined <sup>2</sup>	A	25/32/40
	Fuse separate supply (compressor only)	A	13
	Fuse separate supply, Immersion heater only	A	10/20/32
Performance	SCOP, floor heating (35°C) <sup>3</sup>		5,77
	SCOP, radiator heating (55°C) <sup>3</sup>		4,12
	COP <sup>4</sup>		4,65
Energy class-system <sup>5</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
Energy class-product <sup>6</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
	Hot water (Economy) <sup>7</sup>		A+
	Hot water (Normal/Comfort) <sup>8</sup>		A
Min/Max temperature	Brine	°C	20/-10
	Heating	°C	65/20
Anti freeze type <sup>9</sup>	Ethanol + water solution -17°C ± 2		
Pressure limits refrigerant circuit	Low pressure	bar(g)	2,3
	Operating pressure	bar(g)	41,5
	High pressure	bar(g)	45,0

## Technical description Atlas & Calibra

Sound power level	Calibra	dB(A)	28-43 <sup>10</sup> (32) <sup>11</sup>
	Calibra Duo	dB(A)	32-33 <sup>10</sup> (34) <sup>11</sup>
Hot water performance	Volume 40°C hot water <sup>12</sup>	l	260
	COP, hot water <sup>7</sup>		2,7
	Hot water including HGW <sup>13</sup>	l	n/a
Hot water tank, size	Calibra	l	184
	Calibra Duo	l	Optional
Water mains		bar(g)	9
Weight	Calibra, empty	kg	150
	Calibra, filled	kg	340
	Calibra Duo	kg	115
Dimensions (WxDxH)	Calibra	mm	598x703x1863 +/-10
	not valid	mm	598x703x1450 +/-10

1) The refrigerant circuit is hermetically sealed and contains refrigerants covered by the F-gas regulation. GWP for R410A according to EC 517/2014 is 2088, which gives a CO2 equivalent corresponding to Atlas 12: 2.923 tons, Atlas 18: 4.072 tons.

2) The minimum recommended fuse size depends on the limitation of the electrical immersion heater in combination with the compressor. The maximum permissible power for immersion heater can also be set differently with and without compressor for further adjustment at low fuses. 400V versions: The power supply and the frequency converter for the compressor are powered by L1, L2 and L3. Control and circulation pumps are operated with L1. Meets IEC61000-3-12 at Ssc connection point <1.3 MVA for Atlas 12 and for Atlas 18 <2.1 MVA without action 230V versions: The feeding for auxiliary heater and compressor can be physically separated.

3) SCOP according to EN14825, cold climate (Helsinki), P-design Atlas 12: 10.5 kW (B0W55), 11.5 kW (B0W35). P-design Atlas 18: 15.7 kW (B0W55), 15.1 kW (B0W35).

4) At B0 / W35, according to EN14511

5) When the heat pump is installed in a heating system that is controlled via the heat pump's control computer. According to EU regulation 811/2013.

6) When the heat pump is not connected to a heating system, and the function of the built-in control computer is not taken into account. According to EU regulation 811/2013.

7) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Economy mode and built-in hot water tank.

8) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Normal / Comfort mode and built-in processor.

9) Local regulations and regulations must always be checked before antifreeze agents are used.

10) Sound power level measured according to EN12102 and EN 3741 (min / max B0W35).



11) Sound power level according to energy labeling, measured according to EN12102 and EN3741 (B0W55).

12) Hot water performance according to EN16147, V40 according to XL cycle with the control computer set for comfort mode and built-in hot water tank.



13) Maximum available amount of hot water when the boiler has been able to fully charge using HGW operation and subsequent V40 discharge in accordance with EN16147

## 5.2 Estimated flow and pressure for brine, Calibra 7 and Calibra Duo 7

### Flow brine and external available pressure B0W35 ( $\Delta t$ 3 )

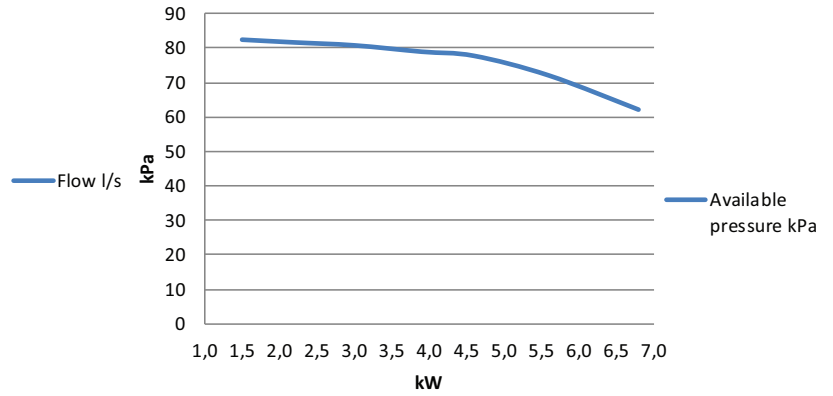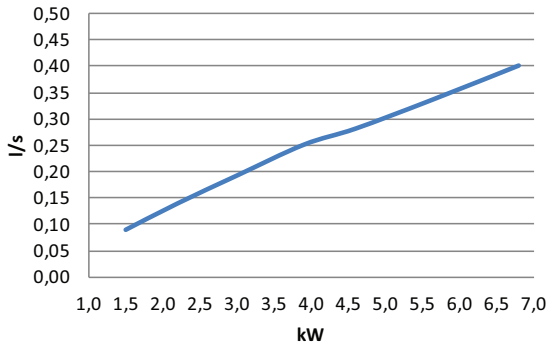



### Flow brine and external available pressure B0W55 ( $\Delta t$ 3 )

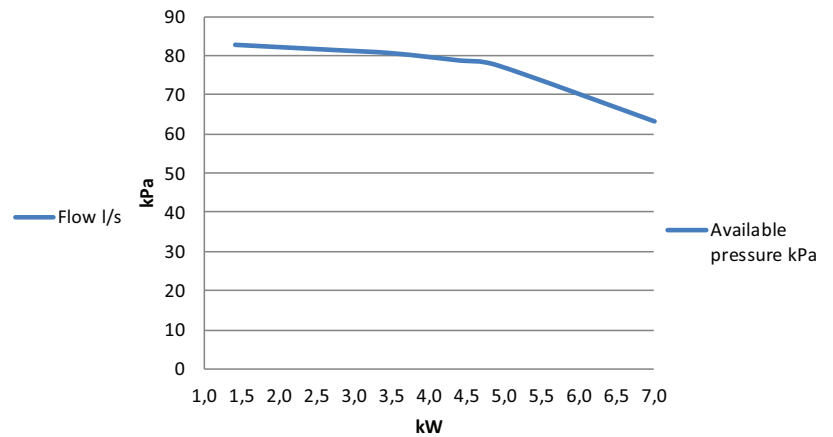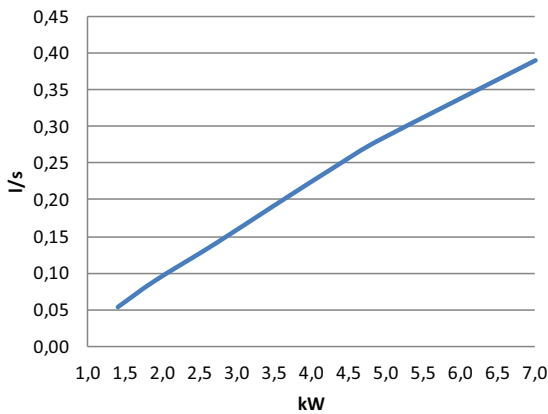



# Technical description Atlas & Calibra

## 5.3 Estimated flow and pressure for heating circuit, Calibra 7 and Calibra Duo 7

### Flow heating circuit and external available pressure B0W35 ( $\Delta t$ 5 )

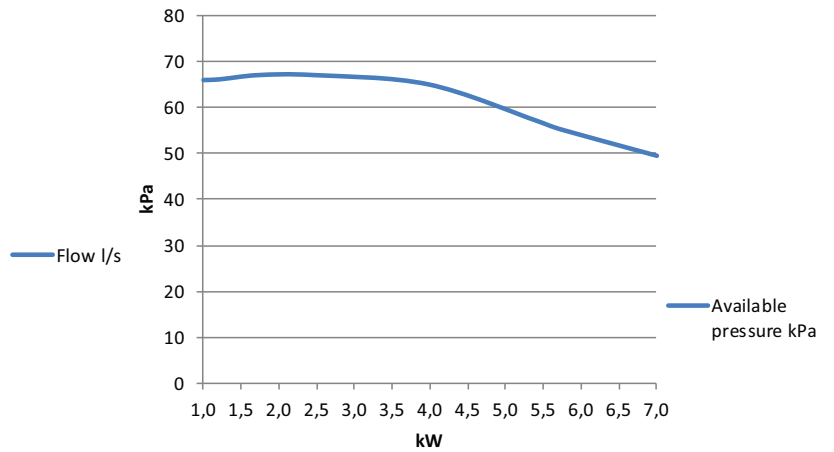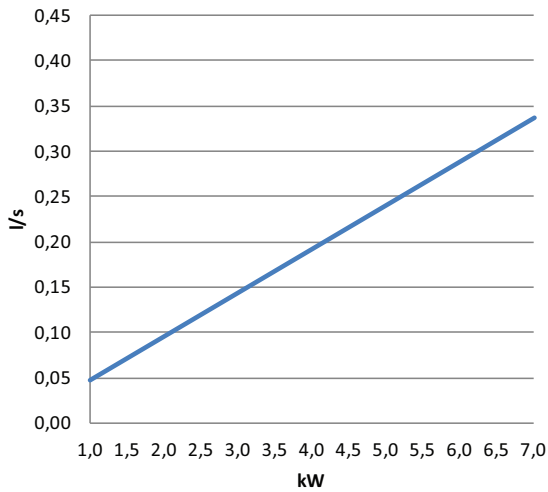


### Flow heating circuit and external available pressure B0W55 ( $\Delta t$ 8 )

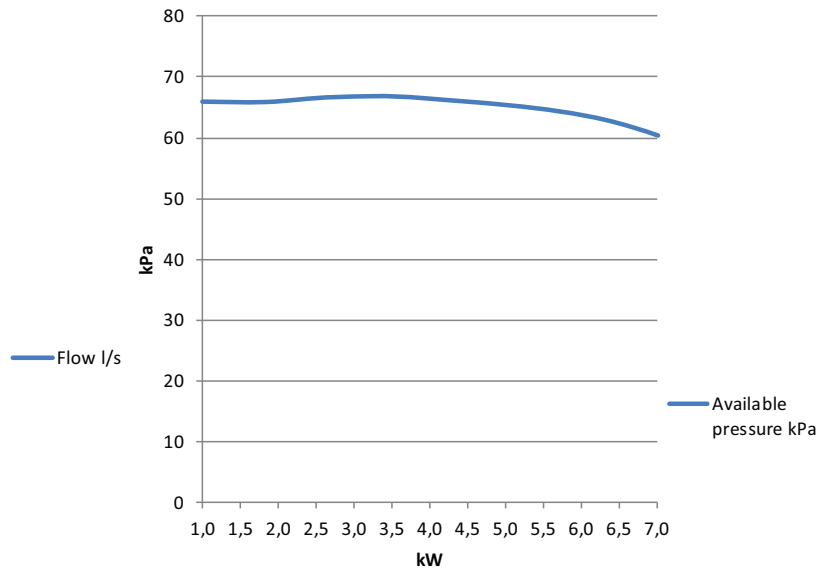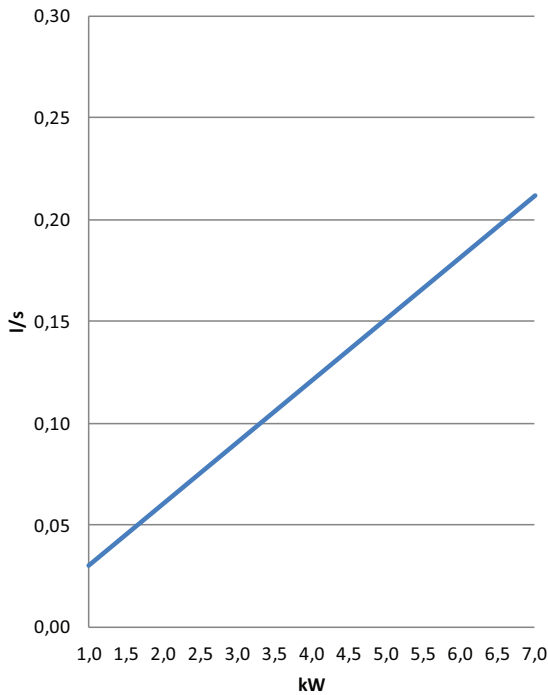

## 5.4 Supply line temp 35°C and 55°C for Calibra 7, Calibra Duo 7


Heating capacity with a desired supply line temperature at 55°C at different compressor speed and brine temperature.

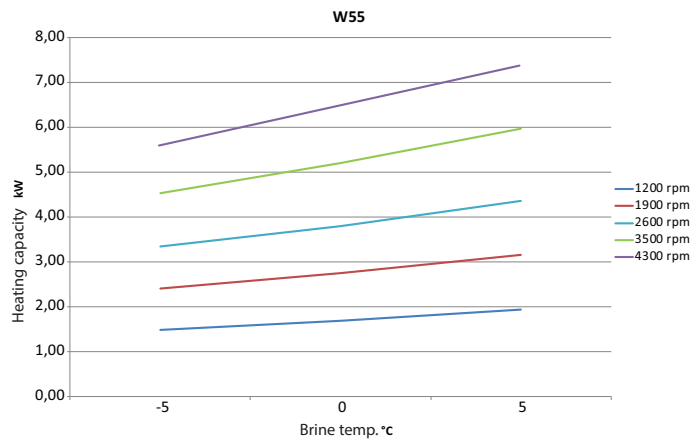

RPM	Brine temp.	-5	0	+5
1200	Heating capacity (kW)	1,5	1,7	1,9
	Input power (kW)	0,8	0,8	0,8
	COP	2,0	2,2	2,5
1900	Heating capacity (kW)	2,4	2,8	3,2
	Input power (kW)	1,0	1,0	1,0
	COP	2,4	2,7	3,1
2600	Heating capacity (kW)	3,4	3,8	4,4
	Input power (kW)	1,3	1,3	1,4
	COP	2,6	2,9	3,2
3500	Heating capacity (kW)	4,5	5,2	6,0
	Input power (kW)	1,8	1,8	1,8
	COP	2,6	2,9	3,3
4300	Heating capacity (kW)	5,6	6,5	7,4
	Input power (kW)	2,2	2,3	2,3
	COP	2,5	2,8	3,2

## Technical description Atlas & Calibra

Heating capacity with a desired supply line temperature at 35°C at different compressor speed and brine temperature.

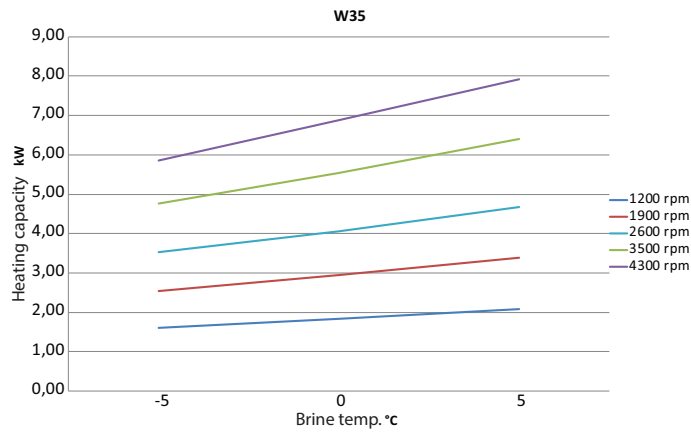

RPM	Brine temp.	-5	0	+5
1200	Heating capacity (kW)	1,6	1,8	2,1
	Input power (kW)	0,5	0,5	0,5
	COP	3,1	3,7	4,4
1900	Heating capacity (kW)	2,6	2,9	3,4
	Input power (kW)	0,7	0,7	0,7
	COP	3,8	4,4	5,2
2600	Heating capacity (kW)	3,5	4,1	4,7
	Input power (kW)	0,9	0,9	0,9
	COP	4,0	4,6	5,3
3500	Heating capacity (kW)	4,8	5,5	6,4
	Input power (kW)	1,2	1,2	1,2
	COP	3,9	4,5	5,2
4300	Heating capacity (kW)	5,9	7,1	7,9
	Input power (kW)	1,6	1,6	1,6
	COP	3,7	4,3	4,9

## 6 Calibra 12 400V & 230V

### 6.1 Technical data, Calibra 12

Calibra 12 400V and 230V		Unit	3-12 kW
Refrigerant	Type		R410A
	Amount <sup>1</sup>	kg	1,40
	CO <sup>2</sup> equivalent	tons	292,3
	Design pressure	Bar (g)	45
Compressor	Type		Scroll
	Oil		POE
Electrical data, 400V, 3-N	Mains power supply	Volt	400~3N
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	3/6/9
	Fuses, combined <sup>2</sup>	A	(10)/13/20/25
Electrical data, 230V, 3-P	Mains power supply	Volt	230~3
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	3/5/8
	Fuses, combined <sup>2</sup>	A	32/32/40
	Fuse separate supply (compressor only)	A	25
	Fuse separate supply, Immersion heater only	A	13/20/32
Electrical data, 230V, 1-N	Mains power supply	Volt	230~1N
	Max working power, compressor	kW	4,3
	Rated power, circulation pumps	kW	0,2
	Immersion heater, 3 steps	kW	3/5/8
	Fuses, combined <sup>2</sup>	A	25/32/40
	Fuse separate supply (compressor only)	A	25
	Fuse separate supply, Immersion heater only	A	16/25/40
Performance	SCOP, floor heating (35°C) <sup>3</sup>		5,8
	SCOP, radiator heating (55°C) <sup>3</sup>		429
	COP <sup>4</sup>		4,75
Energy class-system <sup>5</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
Energy class-product <sup>6</sup>	Floor heating (35°C)		A+++
	Radiator heating (55°C)		A+++
	Hot water (Economy) <sup>7</sup>		A+
	Hot water (Normal/Comfort) <sup>8</sup>		A
Min/Max temperature	Brine	°C	20/-10
	Heating	°C	65/20
Anti freeze type 9	Ethanol + water solution -17°C ± 2		
Pressure limits refrigerant circuit	Low pressure	bar(g)	2,3
	Operating pressure	bar(g)	41,5
	High pressure	bar(g)	45,0

# Technical description Atlas & Calibra

Sound power level	Calibra	dB(A)	29-46 <sup>10</sup> (35) <sup>11</sup>
	Calibra Duo	dB(A)	30-48 <sup>10</sup> (36) <sup>11</sup>
Hot water performance	Volume 40°C hot water <sup>12</sup>	l	260
	COP, hot water <sup>7</sup>		2,7
	Hot water including HGW <sup>13</sup>	l	n/a
Hot water tank, size	Calibra	l	184
	Calibra Duo	l	Optional
Water mains		bar(g)	9
Weight	Calibra, empty	kg	162
	Calibra, filled	kg	352
	Calibra Duo	kg	127
Dimensions (WxDxH)	Calibra	mm	598x703x1863 +/-10
	not valid	mm	598x703x1450 +/-10

1) The refrigerant circuit is hermetically sealed and contains refrigerants covered by the F-gas regulation. GWP for R410A according to EC 517/2014 is 2088, which gives a CO2 equivalent corresponding to Atlas 12: 2.923 tons, Atlas 18: 4.072 tons.

2) The minimum recommended fuse size depends on the limitation of the electrical immersion heater in combination with the compressor. The maximum permissible power for immersion heater can also be set differently with and without compressor for further adjustment at low fuses. 400V versions: The power supply and the frequency converter for the compressor are powered by L1, L2 and L3. Control and circulation pumps are operated with L1. Meets IEC61000-3-12 at Ssc connection point <1.3 MVA for Atlas 12 and for Atlas 18 <2.1 MVA without action 230V versions: The feeding for auxiliary heater and compressor can be physically separated.

3) SCOP according to EN14825, cold climate (Helsinki), P-design Atlas 12: 10.5 kW (B0W55), 11.5 kW (B0W35). P-design Atlas 18: 15.7 kW (B0W55), 15.1 kW (B0W35).

4) At B0 / W35, according to EN14511

5) When the heat pump is installed in a heating system that is controlled via the heat pump's control computer. According to EU regulation 811/2013.

6) When the heat pump is not connected to a heating system, and the function of the built-in control computer is not taken into account. According to EU regulation 811/2013.

7) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Economy mode and built-in hot water tank.

8) Hot water performance according to EN16147, COP according to XL cycle with the control computer set for Normal / Comfort mode and built-in processor.

9) Local regulations and regulations must always be checked before antifreeze agents are used.

10) Sound power level measured according to EN12102 and EN 3741 (min / max B0W35).



11) Sound power level according to energy labeling, measured according to EN12102 and EN3741 (B0W55).

12) Hot water performance according to EN16147, V40 according to XL cycle with the control computer set for comfort mode and built-in hot water tank.



13) Maximum available amount of hot water when the boiler has been able to fully charge using HGW operation and subsequent V40 discharge in accordance with EN16147

## 6.2 Estimated flow and pressure for brine, Calibra 12 and Calibra Duo 12

### Flow brine and external available pressure B0W35 (Δt 3)

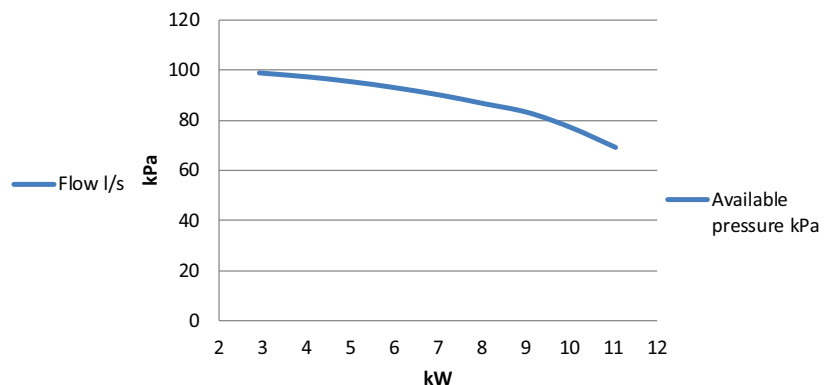
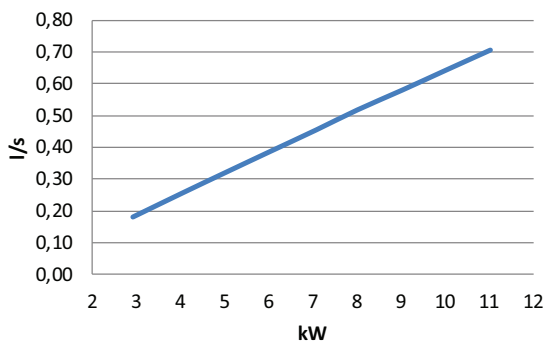


### Flow brine and external available pressure B0W55 ( $\Delta t$ 3 )

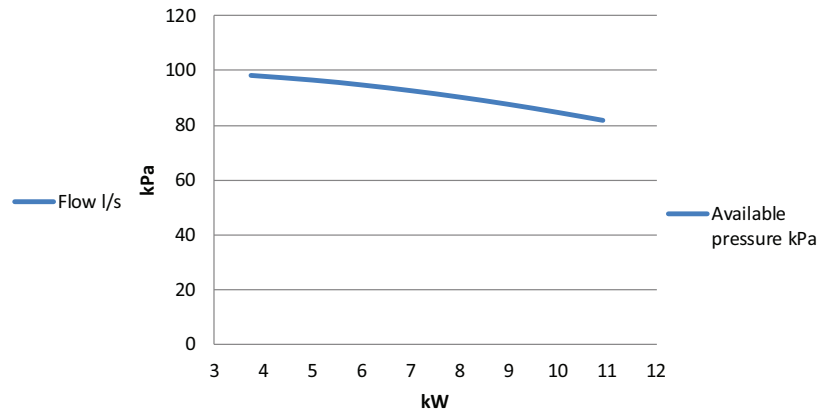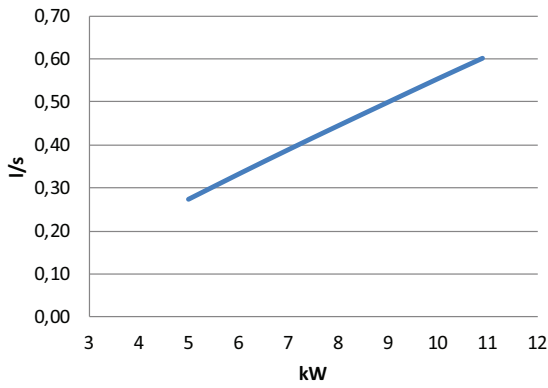



### 6.3 Estimated flow and pressure for heating circuit, Calibra 12 and Calibra Duo 12

#### Flow heating circuit and external available pressure B0W35 ( $\Delta t$ 5 )

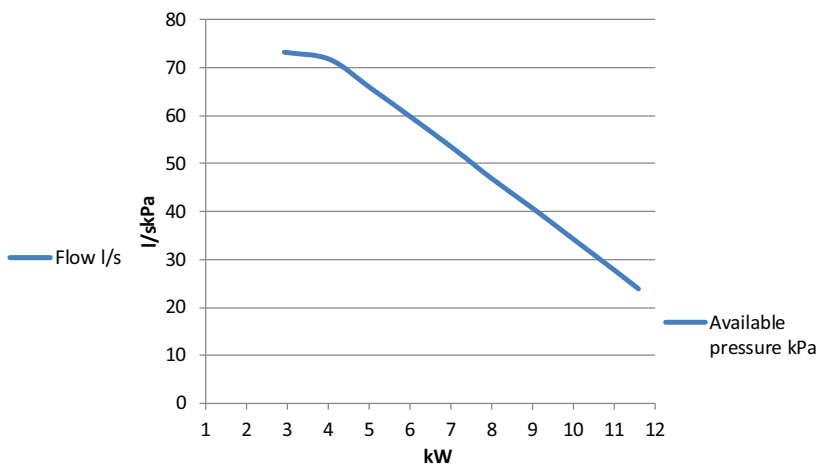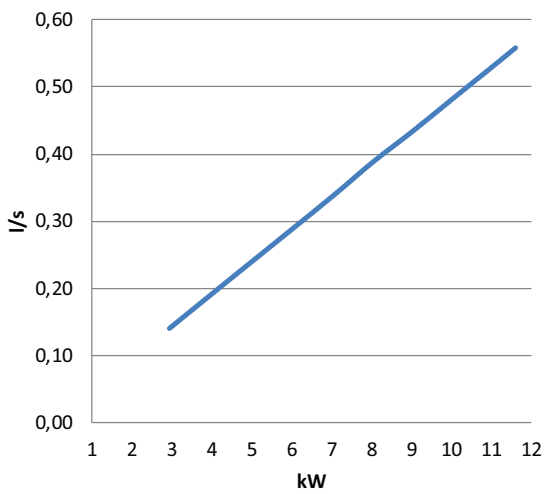


# Technical description Atlas & Calibra

## Flow heating circuit and external available pressure BOW55 ( $\Delta t$ 8 )

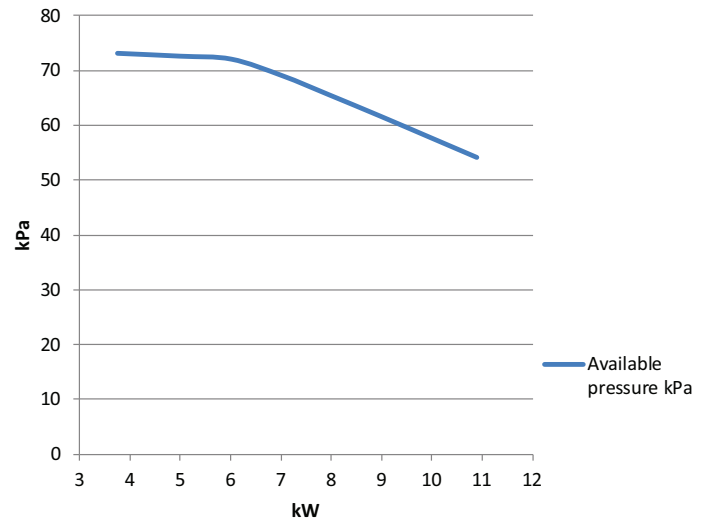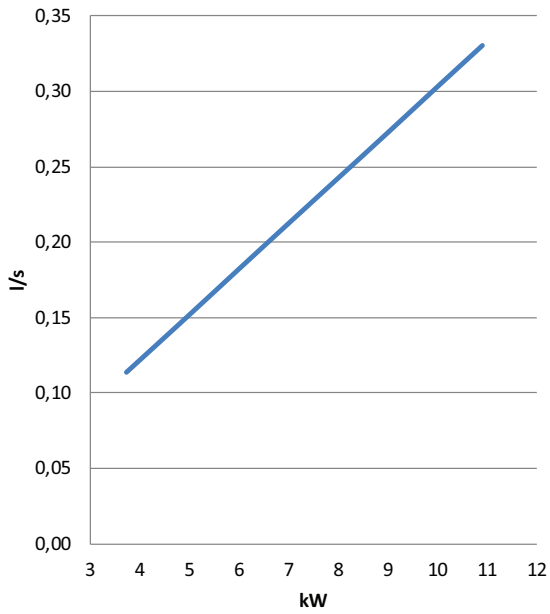

## 6.4 Supply line temp 35° and 55°C for Calibra12 and Calibra Duo 12


Heating capacity with a desired supply line temperature at 35°C at different compressor speed and brine temperature. At higher brine temperatures max compressor speed may be automatically reduced to below 5300 max RPM

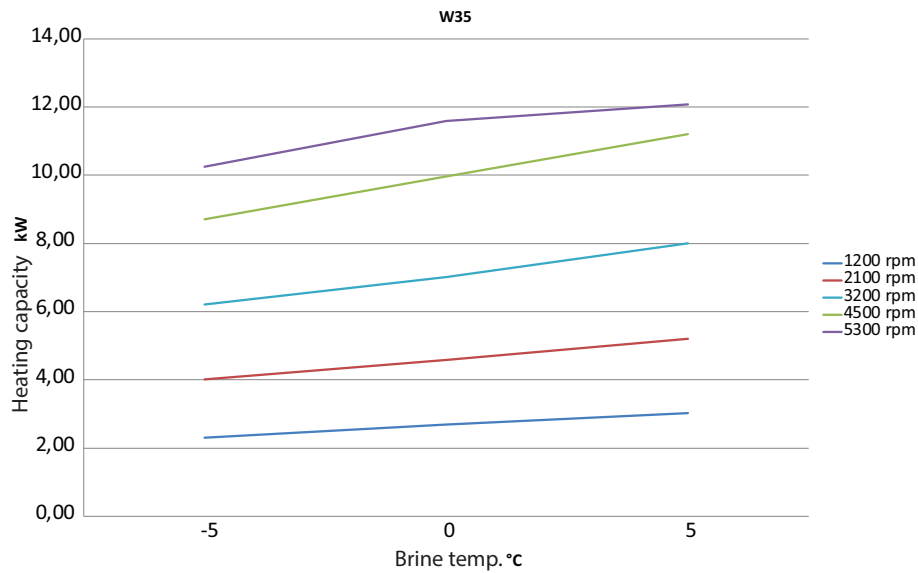

RPM	Brine temp.	-5	0	+5
1200	Heating capacity (kW)	2,3	2,7	3,0
	Input power (kW)	0,7	0,7	0,7
	COP	3,5	4,1	4,6
2100	Heating capacity (kW)	4,0	4,6	5,2
	Input power (kW)	1,0	1,0	1,0
	COP	4,0	4,6	5,3
3200	Heating capacity (kW)	6,2	7,0	8,0
	Input power (kW)	1,5	1,5	1,5
	COP	4,1	4,7	5,3
4500	Heating capacity (kW)	8,7	10,0	11,2
	Input power (kW)	2,2	2,2	2,2
	COP	4,0	4,6	5,2
5300	Heating capacity (kW)	10,2	11,6	12,1
	Input power (kW)	2,6	2,7	2,7
	COP	3,9	4,4	4,6

## Technical description Atlas & Calibra

Heating capacity with a desired supply line temperature at 55°C at different compressor speed and brine temperature. At higher brine temperatures max compressor speed may be automatically reduced to below 5300 max RPM

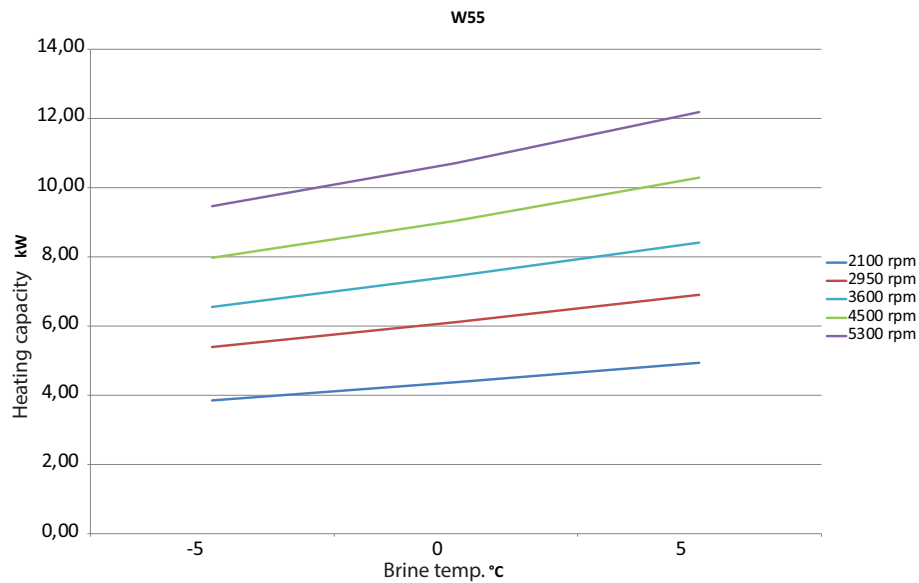

RPM	Brine temp.	-5	0	+5
2100	Heating capacity (kW)	3,9	4,4	4,9
	Input power (kW)	1,5	1,5	1,5
	COP	2,6	2,9	3,2
2950	Heating capacity (kW)	5,4	6,1	6,9
	Input power (kW)	2,0	2,0	2,1
	COP	2,7	3,0	3,4
3600	Heating capacity (kW)	6,6	7,5	8,4
	Input power (kW)	2,4	2,4	2,5
	COP	2,8	3,1	3,4
4500	Heating capacity (kW)	8,0	9,1	10,3
	Input power (kW)	3,0	3,1	3,1
	COP	2,7	3,0	3,3
5300	Heating capacity (kW)	9,5	10,7	12,2
	Input power (kW)	3,7	3,7	3,8
	COP	2,6	2,9	3,2







Thermia AB  
Box 950  
SE 671 29 ARVIKA  
Phone +46 570 81300  
E-mail: [info@thermia.com](mailto:info@thermia.com)  
Internet: [www.thermia.com](http://www.thermia.com)

---

Thermia can accept no responsibility for possible errors in catalogues, brochures and other printed material. Thermia reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Thermia AB and the Thermia AB logotype are trademarks of Thermia AB. All rights reserved.

---