


GOOD TO KNOW ABOUT NIBE™ HPAC 40

Equipment

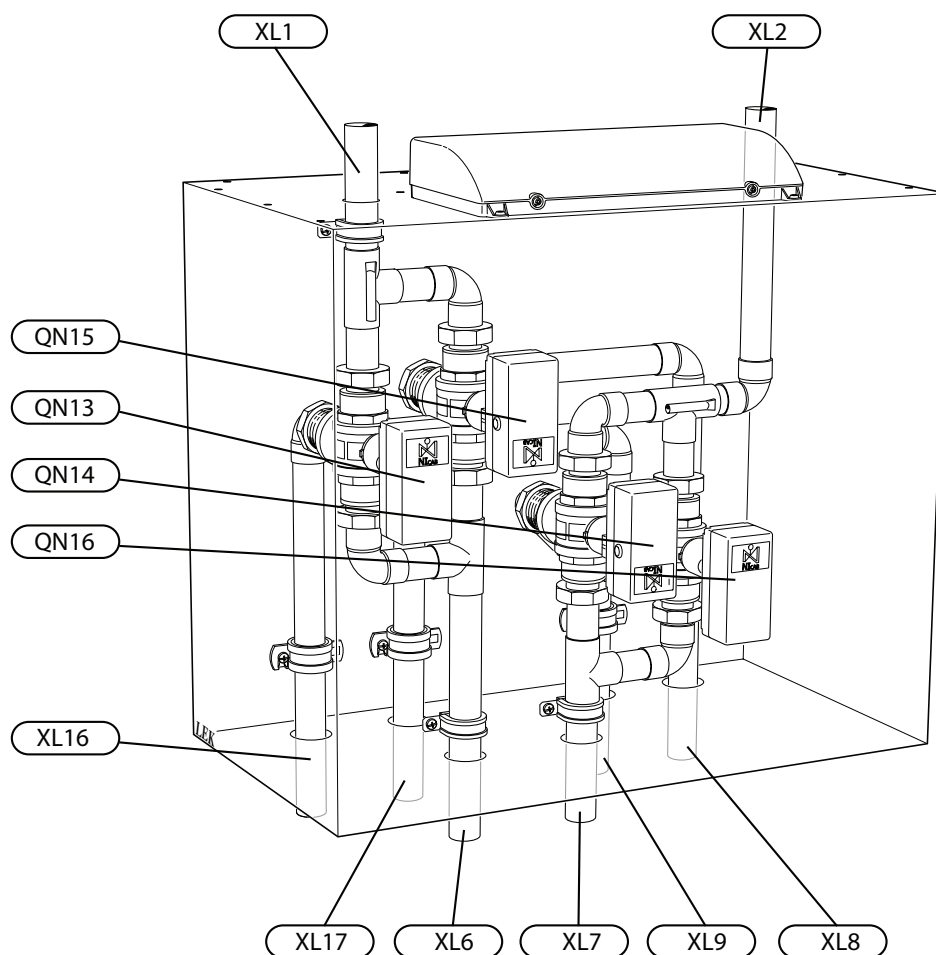

Pipe connections

QN13	Reversing valve 1, active cooling
QN14	Reversing valve 2, passive cooling
QN15	Reversing valve 3, active cooling
QN16	Reversing valve 4, passive cooling
XL1	Docking connection, supply pipe
XL2	Docking connection, return pipe

XL6	Connection
XL7	Connection
XL8	Connection
XL9	Docking
XL16	Docking
XL17	Docking

Designations in component locations according to standard IEC 81346-1 and 81346-2.
*or other external heat source.