



# AWYZ14LBC Capacity/Input data

Heating  
<Capacity>

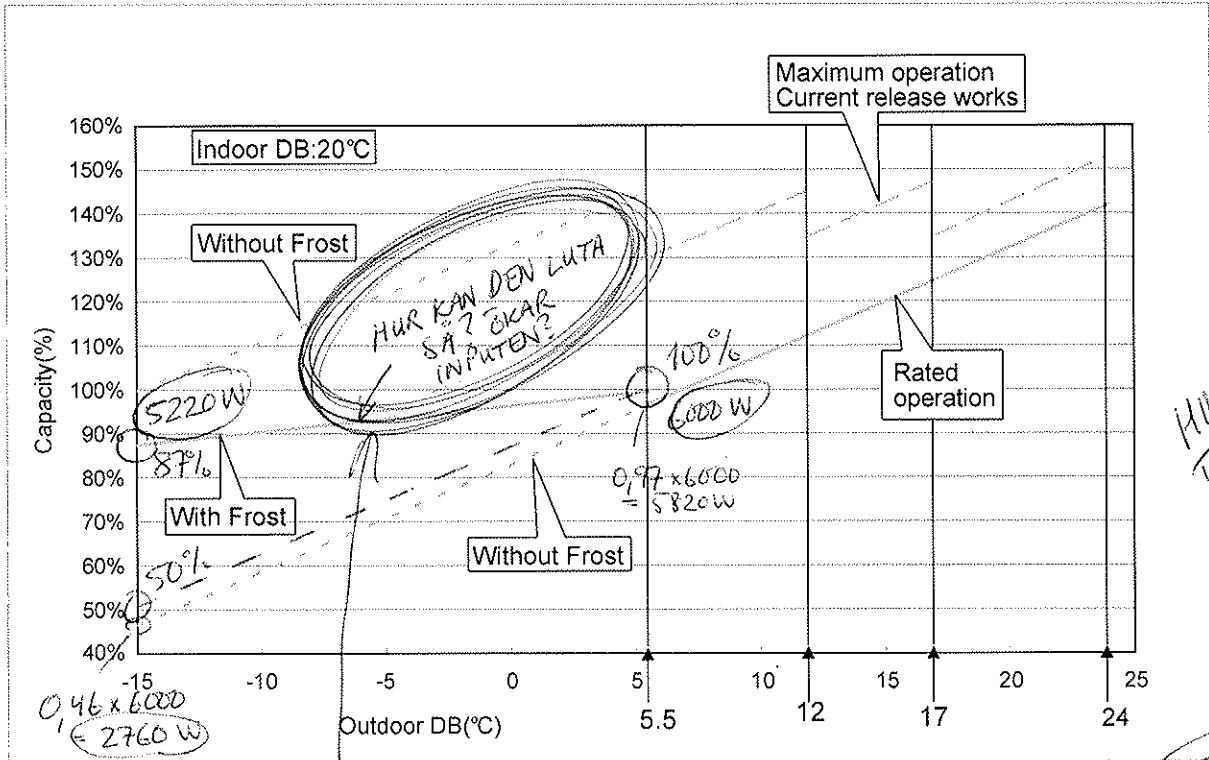

< Input >

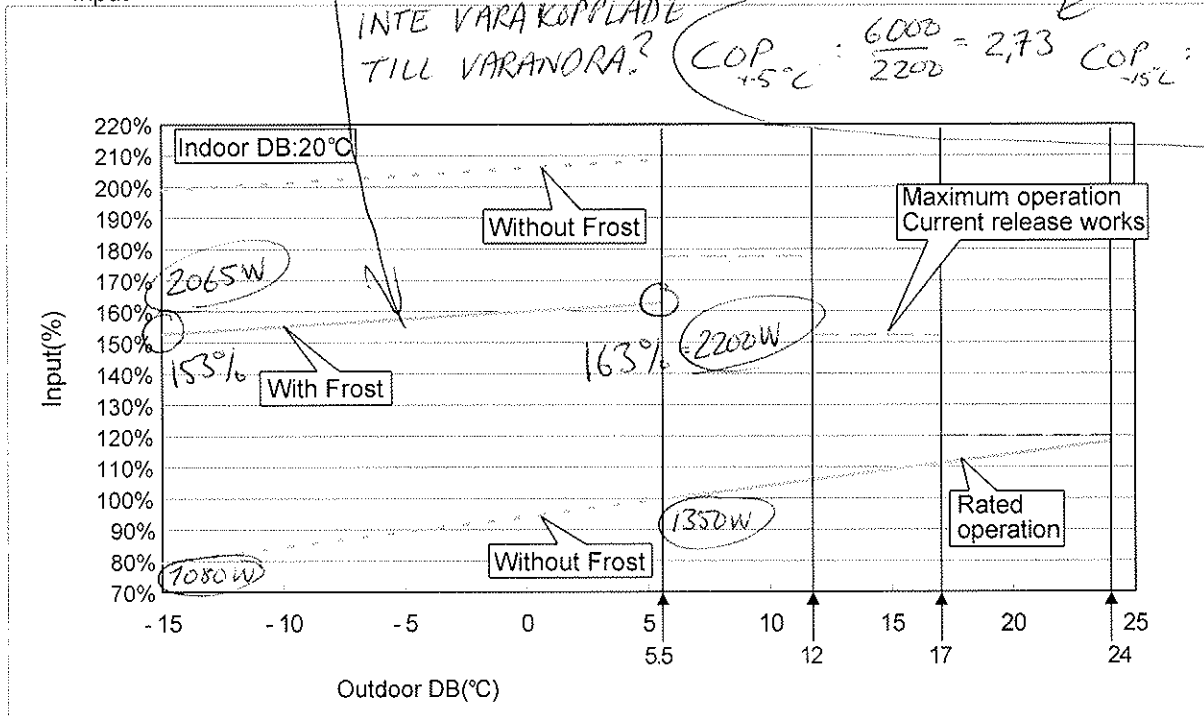

- \*Defrosting operation is performed when temperature is less than 5.5 degrees C. Frost appears on an outdoor unit heat exchanger at 5.5 or less degrees C.
- \*Solid line: Integral capacity/Input containing the defrosting cycle.
- \*Dotted line: Capacity/Input which does not contain the defrosting cycle.

UTAN AVFROSTNING

$COP_{-5°C} = \frac{5820}{1350} = 4.31$ 
 $COP_{-15°C} = \frac{2760}{1080} = 2.55$

HUR KAN DEN TÄPPA SA LITE?

↓

ORIMLIGT

ORIMLIGT

DETTA SER RIMLIGT UT.